



SEMINAR
Pengurusan Halon dan MS:2678.2017
2018
 (Lembah Klang - Sabah - Sarawak - Timur - Selatan - Utara)

History of Refrigeration & Airconditioning

- 1830s - Jacob Perkins - vapor compression (ether)
- 1851 - John Gorrie - patent for air cycle
- 1859 - R-717 / R-718 (ammonia/water)
- 1866 - CO₂ - marine applications
- 1873 - R-717 (ammonia) commercial refrigeration - Carl Linde
- 1875 - R-764 (sulfur dioxide)
- 1920s -R-600a (isobutane) & R-290 (propane)
- 1922 - Willis Carrier - R-1130 (dielene)
- 1926 - R-30 (methylene chloride)

MS2678:2017
Flammable Refrigerant System
Code of Practice
- OVERVIEW -




Ir CHEN Thiam Leong DL&FASHRAE
 FIEM, FIFireE, PE, CE

Common Refrigerants in 1920s

Ammonia (R-717)	NH₃
Carbon Dioxide	CO₂
Sulfur Dioxide	SO₂
Hydrocarbons	C_nH_m
Methyl Chloride	CH₃Cl
Water	H₂O

MS2678 - WG Members

1. ASHRAE Malaysia Chapter
2. Association of Consulting Engineers Malaysia
3. Daikin Research & Development (M) Sdn Bhd
4. Department of Environmental
5. Department of Occupational Safety and Health
6. Ener-Save Sdn Bhd
7. Energy Commission
8. Fire and Rescue Department Malaysia
9. Institut Latihan Perindustrian
10. Kumpulan Arena Sdn Bhd
11. Malaysian Air-Conditioning & Refrigeration Association
12. Pusat Penyelidikan Kebombaan
13. SIRIM Berhad (Secretariat)
14. The Institution of Engineers, Malaysia
15. Universiti Kuala Lumpur
16. Westech Chemicals Sdn Bhd

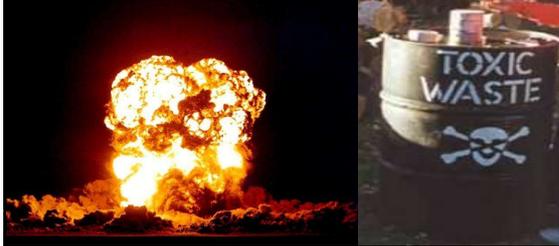EARLY REFRIGERANTS ARE EITHER FLAMMABLE OR TOXIC !




Challenge to Find Refrigerants

(before ODP & GWP)

- Non-flammable
- Good Stability
- Low Toxicity
- Atmospheric Boiling Point between -40°C & 0°C

7




From these elements, CFC refrigerants were formulated.



How are Refrigerants selected?


The Periodic Table

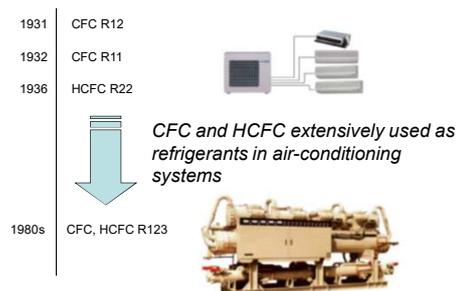CFC and HCFC extensively used as refrigerants in air-conditioning systems



THE PERIODIC TABLE

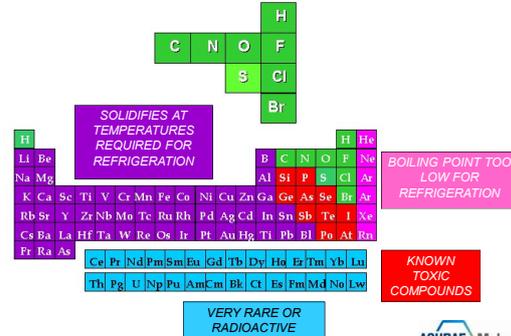

SOLIDIFIES AT TEMPERATURES REQUIRED FOR REFRIGERATION

BOILING POINT TOO LOW FOR REFRIGERATION

KNOWN TOXIC COMPOUNDS

VERY RARE OR RADIOACTIVE



What are the potential replacements?


(post ODP & GWP)

$$\begin{array}{c} \text{F} \\ | \\ \text{F}-\text{C}-\text{Cl} \\ | \\ \text{F} \end{array} \longrightarrow \begin{array}{c} \text{F} \\ | \\ \text{F}-\text{C}-\text{H} \\ | \\ \text{F} \end{array} \longrightarrow$$

ChloroFluoroCarbon (CFC) HydroFluoroCarbon (HFC)



Group	Name	Elements	Commercial Name
CFC	ChloroFluoroCarbon	Chlorine, Fluorine, Carbon	R-11, R-12
HCFC	HydroChloroFluoroCarbon	Chlorine, Fluorine, Hydrogen, Carbon	R-22, R-123
HFC	HydroFluoroCarbon	Fluorine, Hydrogen, Carbon (alkane)	R-134a, R-32
HFO	HydroFluoroOlefin	Fluorine, Hydrogen, Carbon (alkene)	R-1234yf

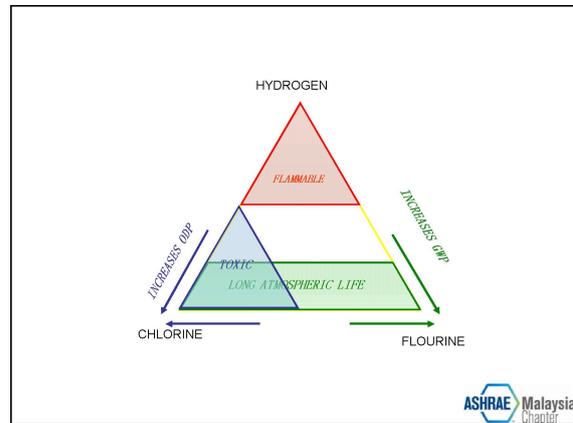

- SELECTING REFRIGERANTS** (post Montreal Protocol)
- ✓ **Physical Consideration**
 - Operating Pressure & Temperature
 - Critical Point
 - Normal Boiling Point
 - Bubble & Dew Point Temperature
 - Fractionalization (Temperature Glide)
 - Flammability
 - Toxicity
 - Operating Pressure
 - Lubrication
 - ✓ **Environmental Consideration**
 - Ozone Depletion Potential (ODP)
 - Global Warming Potential (GWP)
 - Atmospheric Lifetime
 - ✓ **Efficiency**
 - COP

- Overview - Refrigerant Progression**
- Today - 2018**
- The World Scenario:**
- CFCs successfully phased out (circa 2000)
 - HCFC phase out program in progress
 - HFC phase down commenced
 - Low GWP and mildly flammable HFC/HFOs coming on stream
 - HFOs gearing up to replace high GWP HFCs
 - Natural refrigerants progressing at varying pace

Refrigerant			Property				
			Capacity ratio /gas volume	Condensation pressure kPa.a	ODP	GWP	Safety
<reference>	R22	single	100	1943	0.034	1900	O
	R134a	single	62	1319	0	1600	O
Substitute Refrigerants	R407c	Non-azeotropic	98	2111	0	1980	O
	R410a	Quasi-azeotropic	140	3066	0	2340	O
Other Refrigerants	R32	single	162	3141	0	880	A (low flammability)
	Propane	single	82	1713	0	3	X (high flammability)
	Ammonia	single	118	2033	0	0	X (high irritability)
	CO ₂	single	153	5722	0	1	O (toxic)

Advantage
Disadvantage

- Overview - Refrigerant Progression**
- Today - 2018**
- The Local (Malaysia) Scenario:**
- CFC gone and dusted
 - HCFC phase out program in place
 - HFC phase down schedule on the way
 - Naturals (HC) increasingly creeping on board
 - HFC-134a, HFC-410a are prevalent
 - HFC-32 introduced in Indonesia begins to make its mark
 - HFOs beginning to appear
 - RRR practice remains insignificant
 - HCs for domestic refrigerators are finally here!!





Overview - Advent of Flammable Refrigerants

The first generation of refrigerants was all about accepting anything that worked - heralding the era of Natural refrigerants

The second generation addressed concerns on safety (flammability), toxicity & durability - the era of Synthetic refrigerants

The third generation refrigerants sought to protect our ozone layer - the demise of CFCs followed by HCFCs

Today's fourth generation seeks to arrest global warming - completing the circle back to the first generation refrigerants

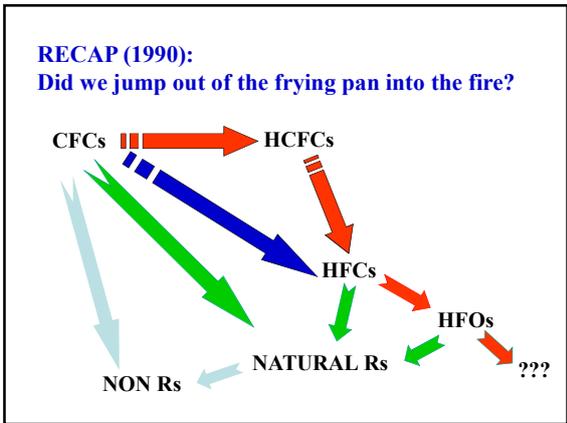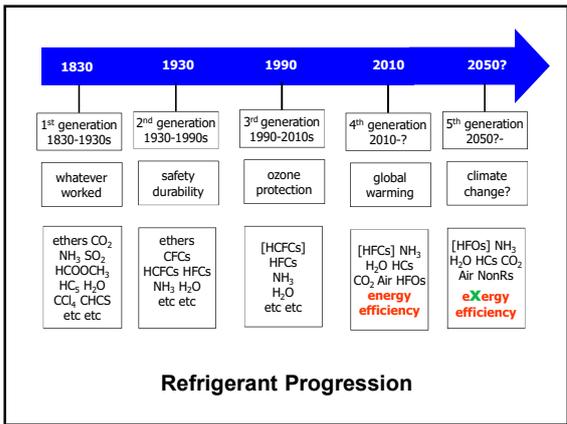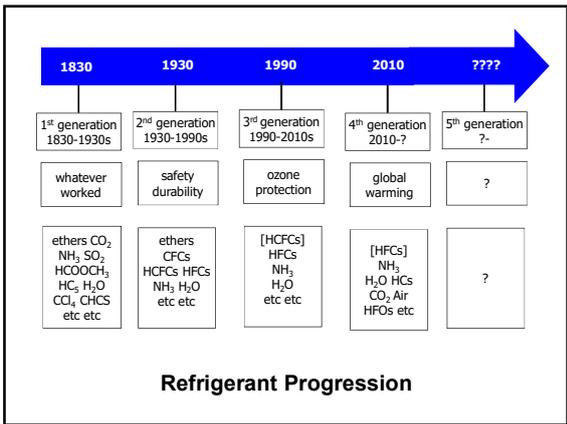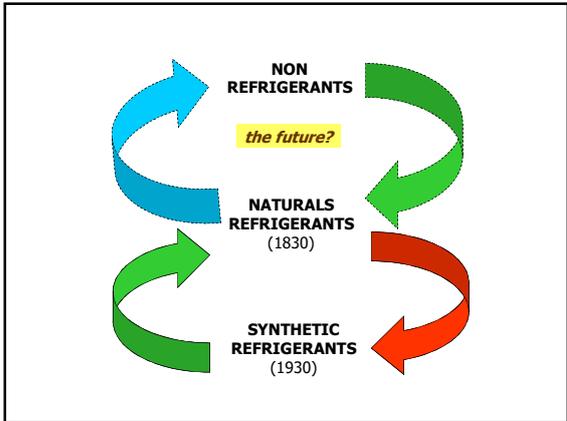

- Natural Refrigerants**
- Certainly European-led and it is heartening to note that the pace has been maintained if not increased since 1997
 - Ammonia chillers for high-rise and commercial buildings are already established but
 - HC airconditioners are prevalent in Scandinavian countries for the last decade
 - HC domestic refrigerants are the norm in Europe; in Japan since 2005 and finally in Malaysia in 2017!!

MS on Flammable Refrigerant System

The need for this MS 2678 was initiated by Bomba
 more than 15 years after the author first presented HC (flammable) refrigerant to the local industry in Jan 2000



2.1 Flammable refrigerant

Flammable refrigerant - Refer to ISO 817 on class A2L, 2 and 3

ISO 817:2014 provides an unambiguous system for assigning designations to refrigerants. It also establishes a system for assigning a safety classification to refrigerants based on toxicity and flammability data, and provides a means of determining the refrigerant concentration limit.

Flammable Refrigerant System

MS 2678 consists of the following sections:

- Section 1: Administration
- Section 2: Definition and classification of flammable refrigerants
- Section 3: Design, construction, testing, marking and documentation
- Section 4: Installation site
- Section 5: Operation, maintenance, repair and recovery

Flammable Refrigerants

Refrigerant No.	Refrigerant Prefix	Chemical Name	Formula	Safety Group
R32	HFC	methylene fluoride	CH ₂ F ₂	A2L
R50	HC	methane	CH ₄	A3
R142b	HCFC	chloro difluoroethane	CH ₂ CClF ₂	A2
R143a	HFC	trifluoroethane	CH ₃ CHF ₃	A2L
R152a	HFC	d fluoroethane	CH ₃ CHF ₂	A2
R170	HC	ethane	CH ₃ CH ₃	A3
R-E170		dimethyl ether	CH ₃ OCH ₃	A3
R290	HC	propane	CH ₃ CH ₂ CH ₃	A3
R600	HC	butane	CH ₃ CH ₂ CH ₂ CH ₃	A3
R600a	HC	isobutane	(CH ₃) ₂ CHCH ₃	A3
R601	HC	pentane	CH ₃ CH ₂ CH ₂ CH ₂ CH ₃	A3
R702		hydrogen	H ₂	A3
R717		ammonia	NH ₃	B2L

Flammable Refrigerant System

The purpose of MS 2678 is to promote the safe design, construction, disposal, installation, and operation of refrigerating systems and equipment using flammable refrigerants.

It is intended to minimize possible hazards to persons, property and the environment from refrigerating systems using flammable refrigerants.

These hazards are associated essentially with the physical and chemical characteristics of flammable refrigerants as well as the pressures and temperatures occurring in refrigeration cycles.

Flammable Refrigerants

Refrigerant No.	Refrigerant Prefix	Chemical Name	Formula	Safety Group
R1150	HC	ethylene	CH ₂ =CH ₂	A3
R1234yf	HFO	tetrafluoropropene	CF ₂ CF=CH ₂	A2L
R1270	HC	propylene	CH ₃ CH=CH ₂	A3
R403A		R290/22/218		A1/A2
R406A		R22/600a/142b		A2/A2
R411A, R411B, R412A, R413A, R415A, R415B, R418A, R419A, R429A, R430A, R431A, R432A, R433A, R433B, R433C, R435A, R436A, R436B, R437				

2.5 Refrigerant Charge Limit

Refrigerant charge limit – Refer ISO 5149-1:2014, Clause 6

6 Quantity of refrigerant per occupied space

6.1 The amount of a refrigerant charge that could enter into the occupied space shall be determined as follows.

- For occupied spaces, the refrigerant quantity shall not exceed the amounts specified in Tables A.1 and A.2

- The refrigerant quantity is the quantity that can be released in an occupied space, and shall be the largest charge of any single refrigerating system, unless otherwise specified in this International Standard.

6.2 Where IEC or ISO product standards exist for particular types of systems and where these product standards refer to refrigerant quantities, such quantities shall overrule the requirements of this part of ISO 5149.

3.2 Design and Construction

• 3.2.2 Marking and instruction

When flammable refrigerants are used, the flammable refrigerant symbol, W021 (refer to Figure 1) shall be displayed appropriately according to ISO 7010.



Figure 1. Flammable material symbol, W021

* Adopted from IEC 60335-2-40 – Clause 7.6

1. When a flammable refrigerant is used, a warning symbol W021 of ISO 7010 ... perpendicular height of the triangle containing the “Caution, risk of fire” symbol shall be at least 30 mm.
2. This marking should be present on all new equipment with all classes of flammable refrigerant


Table 1 - Categories of occupancy

Categories	General characteristics	Examples*
General occupancy a	Rooms, parts of buildings, buildings where - sleeping facilities are provided, - people are restricted in their movement, - an uncontrolled number of people are present, or - to which any person has access without being personally acquainted with the necessary safety precautions	Hospitals, courts or prisons, theatres, supermarkets, schools, lecture halls, public transport termini, hotels, dwellings, and restaurants.
Supervised occupancy b	Rooms, parts of buildings, buildings where only a limited number of people can be assembled, some being necessarily acquainted with the general safety precautions of the establishment.	Business or professional offices, laboratories, places for general manufacturing, and where people work.
Authorized occupancy c	Rooms, parts of buildings, buildings where only authorized persons have access, who are acquainted with general and special safety precautions of the establishment and where manufacturing, processing, or storage of material or products take place.	Manufacturing facilities, e.g. for chemicals, food, beverage, ice, ice-cream, refineries, cold stores, dairies, abattoirs, and non-public areas in supermarkets.

* The list of examples is not exhaustive

Annex B (informative)

Advisory label for installer/service/supplier

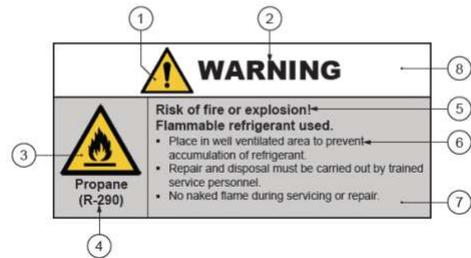

3: Design, Construction, Testing, Marking ..

- Flammable refrigerants shall only be used in equipment or refrigerating system **designed and constructed or retrofitted specifically** for such application and the refrigerant used is clearly identified

3.3 Safety Control measures

- 3.3.1 Duties of installer/supplier/service personnel
 - to provide adequate documentation according to IEC 60335-2-40:2013; Annex HH
 - Advisory label to be affixed permanently
 - To be inspected and certified by an authorised/competent personnel
- 3.3.2 Duties of end users
 - Advised to engage trained service personnel...

4.2.13 Ventilation

- Section 4.2.13.2 – Ventilation in machinery rooms when occupied to be minimum of four air change
- Section 4.2.13.3 – Ventilation system requirement similar to ISO 5149-3:2014 – 5.14.1.2.

*Gas detector required for room with system charge exceeding the Practical Limit


CONCLUDING REMINDER

- Why let 1% continue to dictate 99%?
- Cooling due to chillers accounts for only 15% of our local market
- Refrigerant Efficiency rather than Hardware Efficiency will continue to rule aka
- Energy Efficiency instead of Exergy Efficiency

Requirement on “Trained and Certified Operating Personnel”

- 5.1 General requirements
Operation, maintenance, repairing and refrigerant recovery should be carried out by **trained and certified** personnel in the use of flammable refrigerants. Any personnel conducting an operation, servicing and maintenance on a system or associated parts of the equipment should be **trained and certified**. Personnel working on refrigerating systems with flammable refrigerants should be **trained and certified** to achieve competence in skills and safety aspects of flammable refrigerant handling.

Thermal Efficiency Progression
Chiller Efficiency : kWe/RT

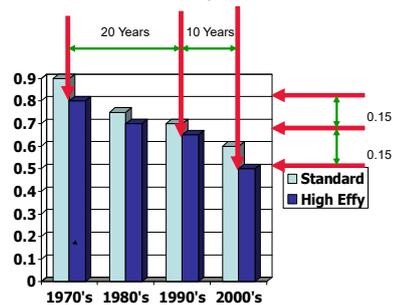

Requirement on “Trained and Certified Operating Personnel” (cont'd)

- The general requirement of trained and certified personnel are indicated as below:
 - a) **Knowledge** of legislation, regulations and standards relating to flammable refrigerants;
 - b) Detailed knowledge of and **skills** in handling flammable refrigerants, personal protective equipment, refrigerant leakage prevention, handling of cylinders, charging, leak detection, recovery and disposal;
 - c) Able to understand and to apply in practice the requirements in this **Malaysia Standard**; and
 - d) **Continuously** undergo regular and further **training** to maintain this expertise

the end
THANK YOU



tlchen55@gmail.com